

AWT100 Data Conversion Module

Installation Manual V1.2

Acrel Co., Ltd.

DECLARATION

All rights reserved. Without the written permission of the company, the contents of any paragraphs and chapters in this manual shall not be excerpted, copied or copied or disseminated in any form, otherwise all consequences shall be borne by the offender.

The company reserves the right to modify the product specifications described in the manual without notice. Before placing an order, please consult your local agent for the new specifications of this product.

Contents

| | |
|---------------------------------------------------------------------------------------|----|
| 1 Overview..... | 1 |
| 2 Product Model..... | 2 |
| 3 Features..... | 2 |
| 4 Typical Applications..... | 3 |
| 5 Technical Parameters..... | 3 |
| 6 Installation and wiring instructions..... | 5 |
| 6.1 Outline and installation dimensions..... | 5 |
| 6.2 Product installation Adopt standard DIN35mm rail type installation..... | 6 |
| 6.3 Terminals and wiring..... | 6 |
| 6.3.1 AWT100-2G/NB/4G/LoRa/LW/GPS/WiFi terminal and wiring..... | 6 |
| 6.3.2 AWT100-CE terminal and wiring..... | 6 |
| 6.3.3 AWT100-DP terminal and wiring..... | 6 |
| 6.3.4 AWT100-2G/NB/4G/LoRa/LW/GPS/WiFi/CE/DP side interface definition..... | 7 |
| 6.4 Panel light definition..... | 8 |
| 6.4.1 Definition of AWT100-2G/NB/4G wireless communication terminal panel lights..... | 8 |
| 6.4.2 Definition of AWT100-LoRa wireless communication terminal panel light..... | 8 |
| 6.4.3 AWT100-LW Definition of wireless communication terminal panel lights..... | 9 |
| 6.4.4 AWT100-GPS Definition of wireless communication terminal panel lights..... | 9 |
| 6.4.5 AWT100-WiFi Definition of wireless communication terminal panel lights..... | 9 |
| 6.4.6 AWT100-CE Ethernet communication panel light definition..... | 9 |
| 6.4.7 AWT100-DP data conversion module panel light definition..... | 9 |
| 6.4.8 AWT100-POW Panel light definition of power module..... | 9 |
| 7 AWT100 Wireless Communication Terminal User Guide..... | 9 |
| 7.1 AWT100 wireless communication terminal configuration..... | 9 |
| 7.2 AWT100 wireless communication terminal parameter description..... | 11 |
| 8 How to use..... | 17 |

1 Overview

At present, wireless technology relies on the advantages of easy deployment, low construction cost, and wide application environment. Data diversification has gradually become an important direction for network development and application in the future industrial Internet. AWT100 data conversion module is a new data conversion DTU launched by Acrel Electric. Communication data conversion includes 2G, 4G, NB, LoRa, LoRaWAN, GPS, WiFi, CE, DP and other communication methods. The downlink interface provides a standard RS485 data interface. It can be easily connected to power meters, RTUs, PLCs, industrial computers and other equipment, and only needs to complete the initial configuration at a time to complete the data collection of the MODBUS equipment; at the same time, the AWT100 series of wireless communication terminals use powerful micro-processing chips to cooperate Built-in watchdog technology, reliable and stable performance.

The appearance is shown in Figure 1.



Figure 1 AWT100 Wireless communication terminal


Features:

- Using single-mode guide rail shape, small size, flexible and convenient installation;
- A variety of mainstream wireless modules, suitable for various on-site environments;
- Multiple hardware interface modes, easy to use with other products;
- Rich communication interface protocols can meet the different needs of customers.

The applicable industries are as follows:

- Wireless meter reading;
- Building automation and security;
- Robot control;
- Power distribution network monitoring, power load monitoring;
- Intelligent lighting control;
- Automatic data collection;
- Industrial remote control and telemetry;
- Highway and railway data transmission;
- Other power and industrial control industries, etc.

2 Product Model

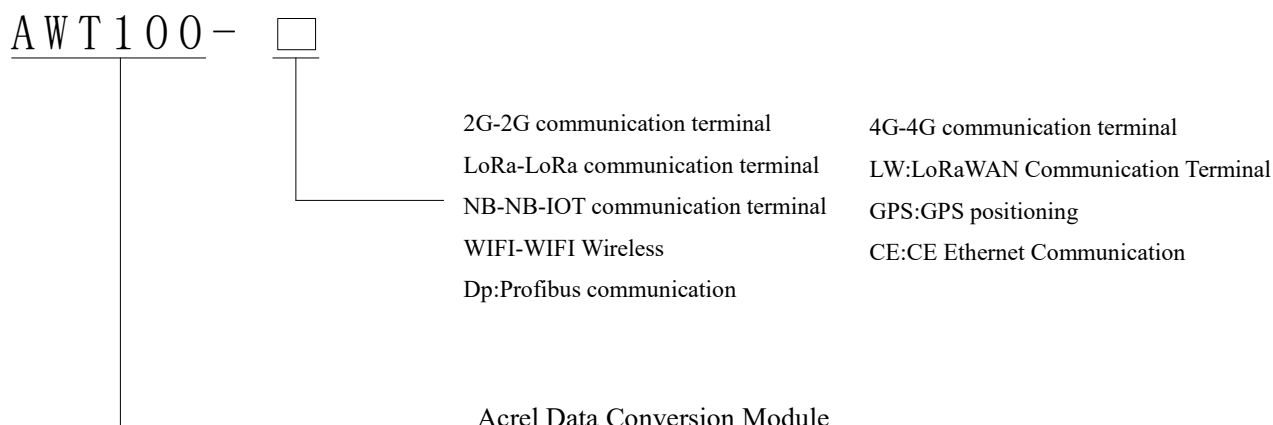

3 Features

- Support serial MODBUS RTU protocol data collection, and communicate with Acrel server through Acrel platform protocol^①.
- Support data collection of up to 30 MODBUS RTU devices.
- Support the collection of 5 register address fields for each MODBUS device, and the address range of each register does not exceed 64.
- Support to preset alarm address and alarm value to trigger alarm for each MODBUS address range. There are currently at most 5 alarm addresses in each address domain.
- Support server MODBUS or LoRa transparent transmission communication.
- Support fixed IP and dynamic domain name resolution methods to connect to the data center.
- Support transparent transmission protocol, general mode (active round copy, regular report), MQTT protocol, smart power wireless protocol, prepaid wireless protocol. It can be customized and developed.
- AWT100-LW wireless communication terminal can upload data to the server through LoRa communication.
- AWT100-GPS wireless module can measure geographic location, obtain latitude and longitude and satellite time.
- The AWT100-WiFi wireless module can automatically access the WIFI hotspot according to the hotspot name and password, realize the transparent transmission of 485 and WIFI data, and also use our cloud platform protocol.
- AWT100-CE can realize data transmission from 485 to Ethernet. It can be used as a TCP client and supports transparent transmission or our cloud platform protocol.
- AWT100-DP can realize data transmission from ProfiBus to MODBUS.

Note: ^①AWT100-2G/NB/4G wireless communication terminal can communicate with the Acrel server through the Acrel platform protocol.

4 Typical Applications

Typical application connections are shown in Figure 2 and Figure 3. Connect the on-site 485 devices to the AWT100 wireless communication terminal. The AWT100 wireless communication terminal will actively collect the data of the 485 device according to its own configuration, and then communicate with the Acrel server.

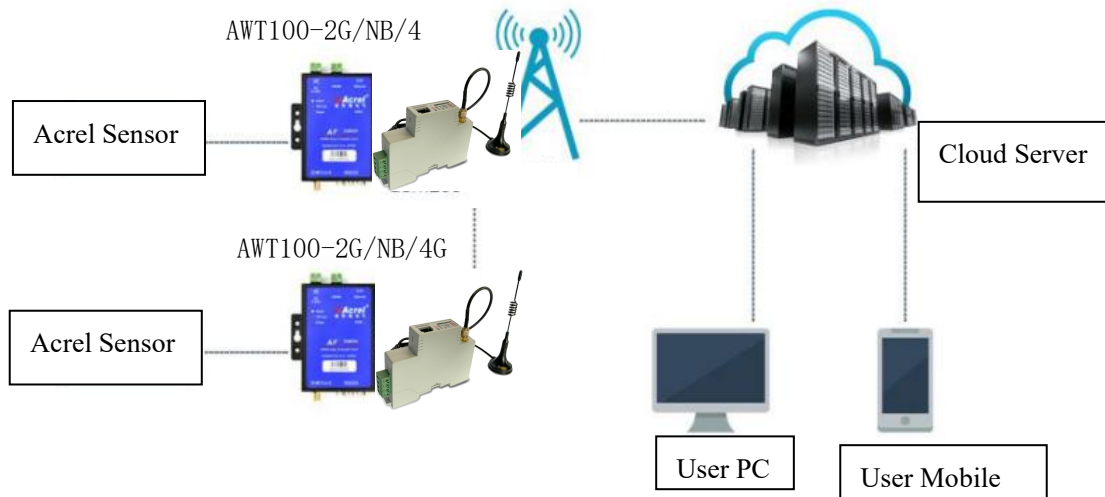


Figure 2 AWT100-2G/NB/4G Typical application of wireless communication terminal

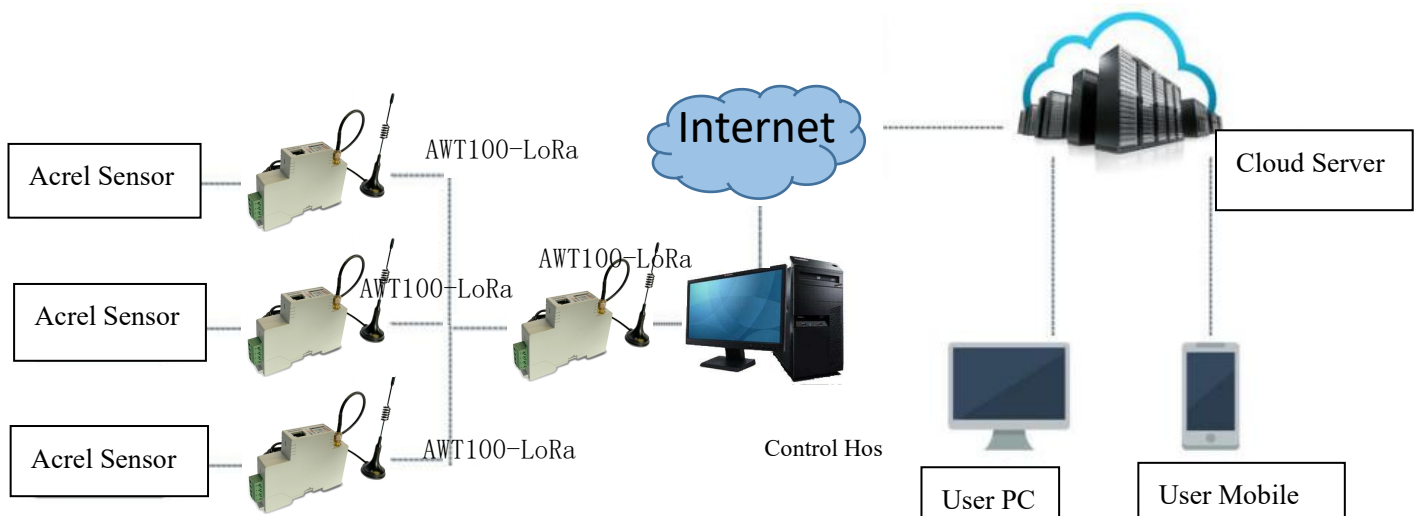


Figure 3 AWT100-LoRa Typical application of wireless communication terminal

5 Technical Parameters

| Parameter Name | AWT100-4G | AWT100-NB | AWT100-2G | AWT100-LoRa AWT100-LW |
|-------------------|--------------------------------------------------------------------------------------|--------------------------|---------------------------------------------|--------------------------|
| Working frequency | LTE-FDD B1 B3 B5 B8 LTE-TDD B34 B38 B39 B40 B41 CDMA B1 B5 B8 GSM 900/1800M | H-FDD B1 B3 B8 B5 B20 | GSM 850 EGSM 900 DCS 1800 PCS 1900 | LoRa 433.00-434.79MHz |

| | | | | |
|-----------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------|------------------------------------------------------------------------|-----------------------------------------------------------------------|
| Transmission rate | LTE-FDD Maximum downlink rate 150Mbps Maximum uplink rate 50Mbps LTE-TDD Maximum downlink rate 130Mbps Maximum uplink rate 35Mbps CDMA Maximum downlink rate 3.1Mbps Maximum uplink rate 1.8Mbps GSM Maximum downlink rate 107Kbps Maximum uplink rate 85.6Kbps | Maximum downlink rate 25.2Kbps Maximum uplink rate 15.62Kbps | GPRS Maximum downlink rate 85.6kbps Maximum uplink rate 85.6kbps | LoRa 62.5kbps |
| Downlink | RS485 Communication | | | |
| Uplink | 4G Communication | NB-IoT Communication | 2G Communication | LoRa Communication |
| SIM card voltage | 3V, 1.8V | | | / |
| Working current | Static power: $\leq 1W$, Transient power consumption: $\leq 3W$ | | | Static power: $\leq 0.5W$, Transient power consumption: $\leq 1W$ |
| Max power consumption | $\leq 0.1W$ | | | |
| Antenna interface | 50Ω/SMA (Faucet) | | | |
| Serial port type | RS-485 | | | |
| Baud rate | 4800bps、9600bps、19200bps、38400bps (default 9600bps) | | | |
| Operating Voltage | DC24V 或 AC/DC220V ^① | | | |
| Operating temperature | -10℃~55℃ | | | |
| Storage temperature | -40℃~85℃ | | | |
| Humidity range | 0~95% Non-condensing | | | |

| Parameter Name | AWT100-LoRa | AWT100-LW | AWT100-LW868 | AWT100-LW923 | AWT100-LORAHW |
|-------------------|--------------------------------------------------------------------|-----------|--------------|--------------|---------------|
| Working frequency | 460~510MHz | 470MHz | 863-870MHz | 920-928MHz | 860-935MHz |
| Transmission rate | LoRa 62.5kbps | | | | |
| Downlink | RS485 Communication | | | | |
| Uplink | LoRa Communication | | | | |
| Working current | Static power: $\leq 0.5W$, Transient power consumption: $\leq 1W$ | | | | |
| Antenna interface | 50Ω/SMA (Faucet) | | | | |
| Serial port type | RS-485 | | | | |
| Baud rate | 4800bps、9600bps、19200bps、38400bps (default 9600bps) | | | | |


| | |
|-----------------------|--------------------------------|
| Operating Voltage | DC24V 或 AC/DC220V ^① |
| Operating temperature | -10℃～55℃ |
| Storage temperature | -40℃～85℃ |
| Humidity range | 0～95% Non-condensing |

| parameter name | AWT100-GPS | AWT100-WiFi | AWT100-CE | AWT100-DP |
|--------------------------|-----------------------------------------------------------------|--------------------------------------------------------|-----------------------------------|----------------------------------------------------------------------------------|
| Work | Positioning accuracy: 2.5-5m | support 2.4G frequency band WiFi rate: 115200bps | Ethernet rate 10/100M adaptive | Profibus address: 1~125. (Note) |
| Downlink | RS485 Communication | | | |
| Uplink | GPS positioning | WiFi wireless | Ethernet communication | Profibus communication |
| Working current | Static power consumption: ≤1W, transient power consumption: ≤3W | | | Static power consumption: ≤0.5W, transient power consumption: ≤1W |
| interface | 50Ω/SMA (Faucet) | | RJ45 | DP9 |
| Serial port type | RS-485 Communication | | | |
| Baud rate | 4800bps、9600bps、19200bps、38400bps (Default 9600bps) | | | |
| Operating Voltage | DC24V or AC/DC220V ^① | | | |
| Operating temperature | -10℃～55℃ | | | |
| Storage temperature | -40℃～85℃ | | | |
| Humidity range | 0～95% Non-condensing | | | |

Note: ①AC/DC220V power supply requires external AWT100-POW power supply module.
 ②Profibus communication rate: 9.6kbps, 19.2kbps, 45.45kbps, 93.75kbps, 187.5kbps, 500kbps, 1.5Mbps, 3Mbps, 6Mbps, 12Mbps. Data exchange length: total input length≤224 bytes, total output length≤224 bytes. The number of downstream instruments connected: 1~80.

6 Installation and wiring instructions

6.1 Outline and installation dimensions

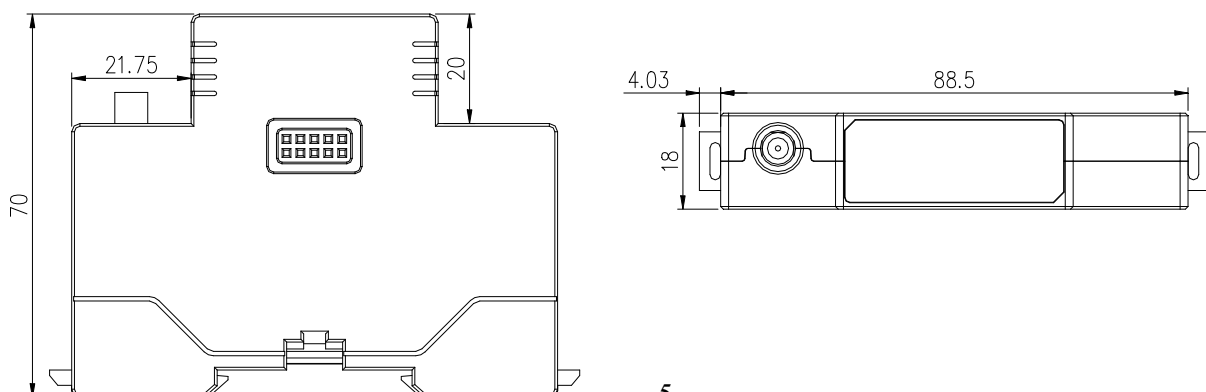


6.2 Product installation


Adopt standard DIN35mm rail type installation.

6.3 Terminals and wiring



6.3.1 AWT100-2G/NB/4G/LoRa/LW/GPS/WiFi terminal and wiring

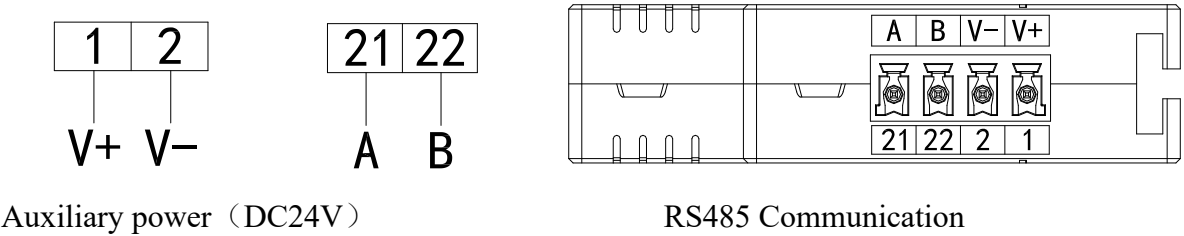

The function of the network port is the power interface and the RS485 interface. The specific definitions are as follows:

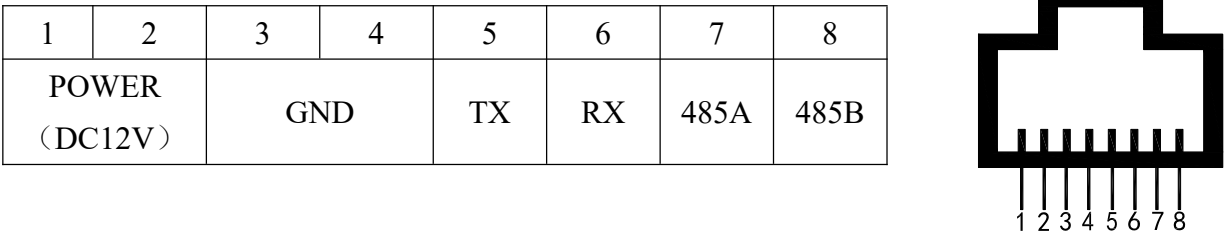



6.3.2 AWT100-CE terminal and wiring

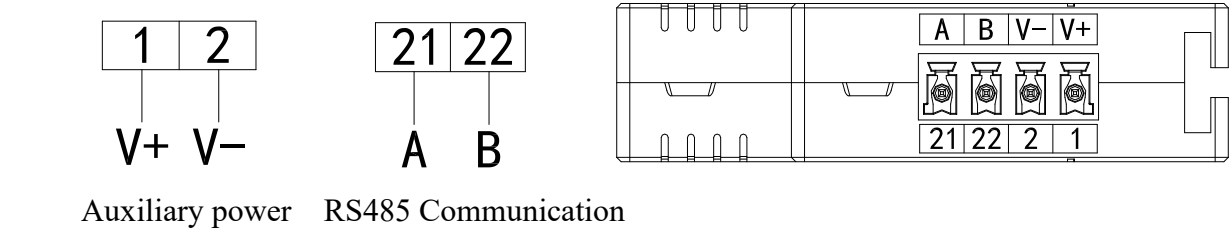


Ethernet communication

6.3.3 AWT100-DP terminal and wiring

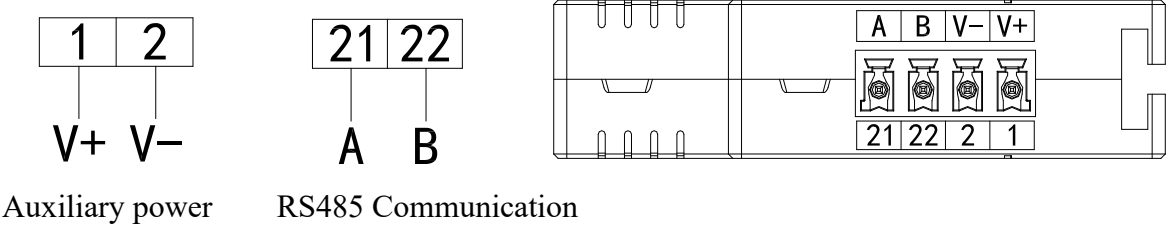


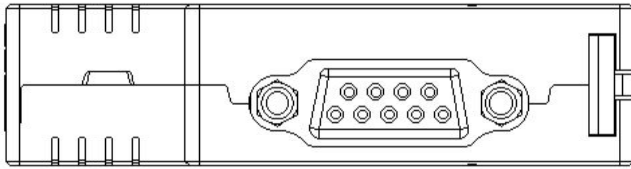


6.3.4 AWT100-2G/NB/4G/LoRa/LW/GPS/WiFi/CE/DP side interface definition

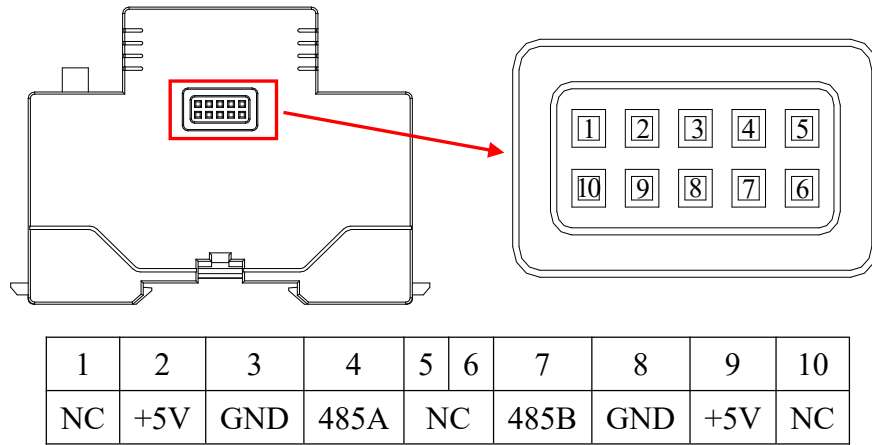


Note: The two interfaces of network port and terminal can only be used by one of the two (except for AWT100-CE), and cannot be used at the same time.

Power module terminal definition

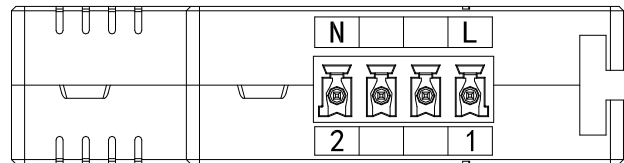

Auxiliary power (AC/DC 220V)

Side interface definition

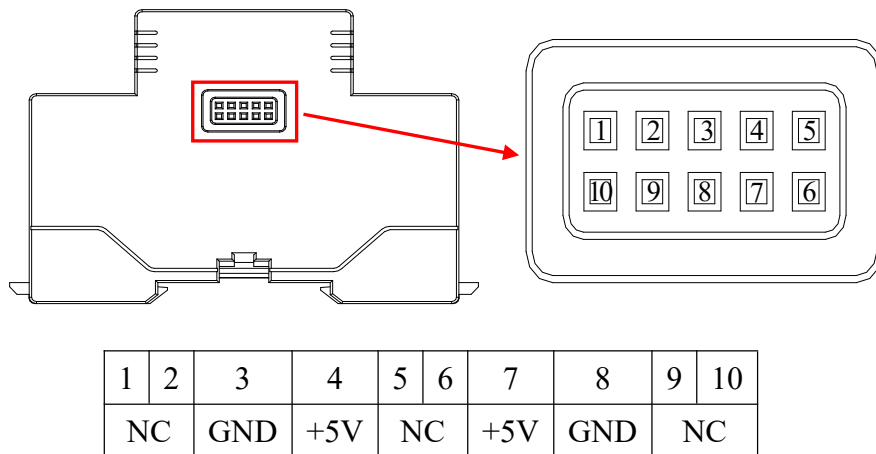

The side interface is used for the AWT100 wireless communication terminal to supply power through the AWT100-POW power module AC220V. The AWT100 wireless communication terminal is connected to the AWT100-POW power supply module through pins and fixed together by a buckle. The connection diagram is shown in Figure 4:

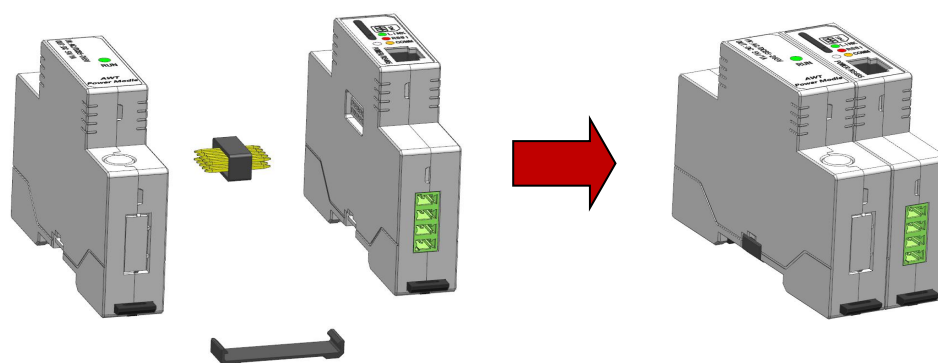


Figure 4

Installation Notes:

- ① When the AWT100 wireless communication terminal is powered by the AWT100-POW power supply module, the auxiliary power terminal and network port of the AWT100 wireless communication terminal The 24V power supply cannot be connected again.
- ② Antenna installation, the antenna interface of the AWT100 wireless communication terminal adopts 50Ω/SMA (female), and the external antenna must be an antenna suitable for the working band. If other unmatched antennas are used, it may affect or even damage the equipment.
- ③ When installing the SIM card, make sure that the device is not powered on. The SIM card of the AWT100 wireless communication terminal adopts a card tray installation method. You need to put the SIM card in the card tray correctly, and then insert the SIM card into the card holder of the device.

6.4 Panel light definition

6.4.1 Definition of AWT100-2G/NB/4G wireless communication terminal panel lights

| ● LINK (Green) | ● RSSI (Red) | ● COMM (Orange) |
|-----------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------|
| The green indicator flashes for 2 seconds, the wireless module is being initialized | The red indicator flashes for 3 seconds to indicate that the signal is less than 20% | The orange indicator flashes to indicate that there is network data communication |
| The green indicator flashes for 1 second, connecting to the server | | |
| The green indicator light is always on to indicate that the server is connected and the signal strength is greater than 20% | | |

6.4.2 Definition of AWT100-LoRa wireless communication terminal panel light

| ● RUN (Green) | ● LoRa (Red) | ● COMM (Orange) |
|------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------|
| The green indicator light is always on, indicating that the meter has been able to operate normally. | The red indicator light flashes for 1 second when there is a LoRa signal to receive and send data. | The orange indicator light flashes for 1 second when there is 485 to receive and send data. |

6.4.3 AWT100-LW Definition of wireless communication terminal panel lights

| ● RUN: (Green) | ● LoRa (Red) | ● COMM (Orange) |
|----------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|
| The green indicator flashes for 1 second and the gateway is connecting. | The red indicator flashes for 1 second when there is LoRa signal to receive and send data. | The orange indicator flashes for 1 second when there is 485 to receive and send data. |
| The green indicator light is always on to indicate that the gateway has been connected | | |

6.4.4 AWT100-GPS Definition of wireless communication terminal panel lights

| ● RUN (Green) | ● LoRa (Red) |
|---------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|
| The green indicator light is always on, indicating that the power supply voltage is normal. | After the positioning is successful, it flashes for 1 second and the green indicator light is off |

6.4.5 AWT100-WiFi Definition of wireless communication terminal panel lights

| ● RUN (Green) | ● LoRa (Red) |
|-------------------------------------------------------|------------------------------------------|
| Blinking in connection, the connection is successful. | Blinking when there is data transmission |

6.4.6 AWT100-CE Ethernet communication panel light definition

RJ45: Ethernet interface

6.4.7 AWT100-DP data conversion module panel light definition

Digital tube: display Profibus address (1~99)

USB interface: configure the module parameters, connect to the upper computer

DB9 interface: communicate with upstream DP equipment, Profibus_DP protocol

485 interface: communication with downstream instruments, Modbus_Rtu protocol

6.4.8 AWT100-POW Panel light definition of power module

The green indicator light is always on to indicate that the power module is operating normally. If the indicator light is off, it indicates that the module is not powered on or is faulty.

7 AWT100 Wireless Communication Terminal User Guide

7.1 AWT100 wireless communication terminal configuration

Before using the AWT100 wireless communication terminal, the user can configure the parameters of the AWT100 wireless communication terminal according to the actual situation. The operation process is as follows:

- (1) The AWT100 wireless communication terminal is powered on, and the working indicator of the AWT100 wireless communication terminal flashes, indicating that the AWT100 wireless communication terminal has started to work.
- (2) Start the configuration software of the AWT100 wireless communication terminal, which consists

of the computer serial port parameter area, information display area, parameter setting area, parameter reading and setting buttons, as shown in Figure 5.

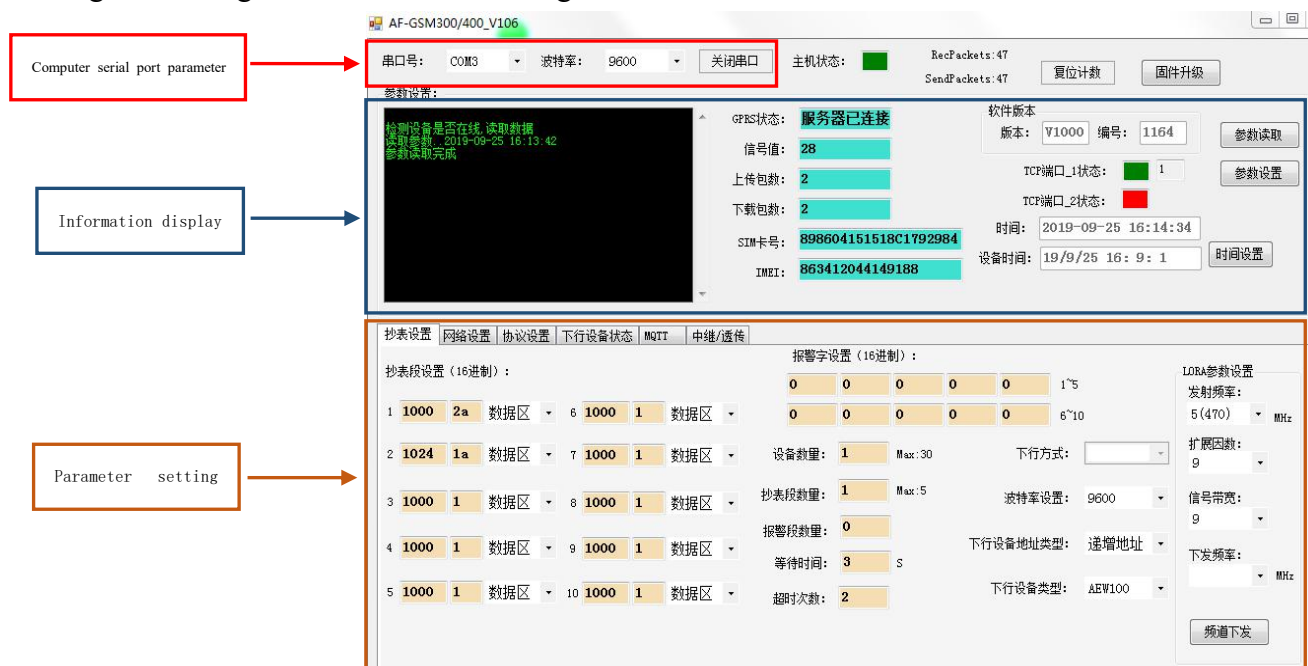


Figure 5

The AWT100 wireless communication terminal configuration software can read and set parameters, and can test the working status of the AWT100 wireless communication terminal. Please confirm the serial port number of the currently used serial port, modify the serial port number, and keep the serial port baud rate consistent, and click "open serial port" after confirmation. After the serial port is successfully connected to the host computer (the host status box turns green) **主机状态: [green box]**。

(3)AWT100-2G/4G/NB wireless communication terminal parameter reading

Click the **参数读取** button in the upper right corner, to display all the parameter values inside the AWT100 wireless communication terminal, as shown in Figure 5.

(4)AWT100-2G/4G/NB wireless communication terminal parameter setting

Click the parameter value to be modified, directly input or modify the corresponding parameter value, Click the **参数设置** button in the upper right corner to complete the parameter setting.

7.2 AWT100 wireless communication terminal parameter description

(1) AWT100-2G/4G/NB wireless communication terminal connection status



● GPRS status

Display the connection status between the AWT100-2G/4G/NB wireless communication terminal

and the server.

- Signal value

Indicates the signal strength of the connection between the AWT100-2G/4G/NB wireless communication terminal

and the server. The larger the value, the stronger the signal.

- Number of upload packages

Indicates the number of data packets uploaded by the AWT100-2G/4G/NB wireless communication terminal to the server.

- Number of download packages

Indicates the number of data packets received from the server by the AWT100-2G/4G/NB wireless communication terminal.

- SIM card number

Insert the SIM card number of the AWT100-2G/4G/NB wireless communication terminal.

- IMEI

The device identification code of the AWT100-2G/4G/NB wireless communication terminal.

(2) AWT100 wireless communication terminal software information

软件版本
版本: V1000 编号: 1164 参数读取
TCP端口_1状态: 1 参数设置
TCP端口_2状态:
时间: 2019-09-25 16:40:00
设备时间: 19/9/25 16:34:27 时间设置

- version

Software version of AWT100 wireless communication terminal。

- serial number

Software version of AWT100 wireless communication terminal。

- TCP port_1 status

■Green indicates that the AWT100-2G/4G/NB wireless communication terminal is successfully connected to the server port .■Red indicates that the AWT100-2G/4G/NB wireless communication terminal failed to connect to the server port.

- TCP port_2 status

TCP port_2 is currently not used。

- Time

The system time of the current computer.

- Equipment time

Equipment time of wireless communication terminal AWT100-2G/4G/NB,Click 时间设置 the device time of the AWT100-2G/4G/NB wireless communication terminal can be synchronized with the current computer system time.

● Data area

The first box in the data area indicates the starting MODBUS address of the register of the downstream device, and the second box indicates the meter reading length (not more than 64), for example **1000** **2a** 数据区, indicates to start meter reading from the downstream device address 1000H, the address length is 2a (hexadecimal).

●Parameter area

The parameter area can be selected from the drop-down . The data in the parameter area can be uploaded to the server once when the device is powered on, once a day, or when the data changes.

● Alarm word

setting 10 alarm words of addresses can be set, and data will be uploaded when the alarm word of the set address changes.

● Number of equipment

The number of meter readings is set, and the data collection of up to 30 MODBUS RTU devices is supported.

● Number of meter reading segments

The number of register address fields collected by each MODBUS device shall not exceed 5.

● Number of alarm segments

The total number of alarm words to be set is up to 10, and the number of settings should be consistent with the number of alarm words.

● Waiting time

Wait for the response time of the downstream device.

● Number of timeouts

If the number of reconnections of the downlink device exceeds the specified number, it is considered that the downlink device is disconnected from the AWT100 wireless communication terminal.

● Downlink

The default 485 bus communication (LoRa communication is optional).

● Downstream device address type

Use the MODBUS address to read the meter and the serial number (14-digit) address to read the meter.

● Downstream equipment type (Reserved) (4) AWT100-2G/4G/NB wireless communication terminal network setting parameters

| 抄表设置 | 网络设置 | 协议设置 | 下行设备状态 | MQTT | 中继/透传 | |
|---------|-----------------|---------|----------------|------|-----------|------|
| IP_1地址: | 121 196 207 228 | 设备号: | ZHYDTEST000001 | | 连接方式: | IP地址 |
| IP_1端口: | 6879 | 数据上传间隔: | 5 | Min | TCP连接总数: | 1 |
| IP_2地址: | 0 0 0 0 | 参数上传间隔: | 1440 | 分 | 网络超时时间: | 10 s |
| IP_2端口: | 0 | | | | 网络超时重试次数: | 2 |
| 域名设置_1: | www.acrel.com | | | | | |
| 域名设置_2: | www.acrel.com | | | | | |

- IP_1 address
The IP address of the first server to connect to.
- IP_1 port
Connect the IP port of the first server.
- IP_2 address
Connect to the IP address of the second server.
- IP_2 port
Connect the IP port of the second server.
- Domain name
setting_1 The domain name of the first server to connect to.
- Domain name setting_2
The domain name of the second server to connect to.
- Device number
Device serial number (14 digits).
- Data upload interval
The data upload time interval in the data area, the default is 5min.
- Parameter upload interval
The data upload time interval in the data area, the default is 1440min.
- Connection method
The connection address method with the service area (IP/domain name).
- Total number of TCP connections
The number of servers connected at the same time.
- Network timeout
The time to wait for a response from the server.
- Number of network timeout retries
The number of retransmissions to the server.

(5) AWT100-2G/4G/NB wireless communication terminal protocol setting parameters

| 抄表设置 | 网络设置 | 协议设置 | 下行设备状态 | MQTT | 中继/透传 |
|--------|------|------|----------------------------------|---------|-------|
| 编码因子1: | | ST: | 53 | 通信协议选项: | 安全用电 |
| 编码因子2: | | MN: | 000000000000000000000000 num: 24 | 协议内部选项: | 无序列号 |
| 编码分类: | t | | | | |
| 工艺编码表: | 1 | | | | |

- Coding factor 1
- Coding factor 2
- Code classification
- Process coding
- ST
- MN
- Communication protocol options
- Protocol internal options The above are the relevant agreement parameters involved in each area of the HJ212 environmental protection agreement, which depends on the agreement.

(6) Downlink device status of AWT100-2G/4G/NB wireless communication terminal

• Downlink device status

Click can read the status of all downstream devices .Click can read the status of a single downstream device.Click can write the serial number of the downstream device (when using the MODBUS address to read the meter,there is no need to write the serial number).■Red indicates that the downstream device is offline.■Green indicates that the downstream device is online .E.g .Indicates that the device with the serial number 20190903000001 is online.

(7) AWT100-LoRa Wireless communication terminal relay/transmission parameters

Relay/transparent transmission setting options are used to set the wireless parameter settings of the AWT100-LoRa wireless communication terminal , Click the button can read the wireless parameter settings of the AWT100-LoRa wireless communication terminal. After modifying the wireless parameters of the AWT100-LoRa wireless communication terminal , Click the button to complete parameter setting。

- Relay transmission frequency

The frequency of relay transmission: 460 ~ 510MHz. If the working mode of the AWT100-LoRa wireless communication terminal is set to relay mode, the relay transmission frequency must be inconsistent with the transparent transmission frequency.

- Transparent transmission frequency

The frequency of transparent transmission: 460 ~ 510MHz.

- Expansion factor

LoRa spreading factor


- Signal bandwidth

LoRa signal bandwidth

- Type

Set the working mode of the AWT100-LoRa wireless communication terminal. There are two ways to choose from: transparent transmission and relay.

(8) AWT100-GPS positioning module parameter settings

Latitude: 31° 50' .9286 N Visible satellites: 7 Positioning interval: 1000 ms
 Longitude: 120° 12' .2540 E Used satellites: 7 Address: 1 Baud rate: 9600
 Positioning time: 2021/1/8 8:38:05 GPS module communication status:  [Parameter Reading](#) [Parameter Setting](#)

Positioning interval: latitude and longitude refresh interval.

Positioning time: positioning satellite time.

| AWT_GPS modbus register address table and description | | | | | |
|-------------------------------------------------------|-----------------|----------------------------|---------------------|-----------------|--------------------------------------------------------------------------|
| Adress | Register number | name | Number of registers | Attributes(W/R) | Description |
| 0000H | 1 | contact address | 1 | W/R | Value range 1~127, universal address 0 |
| 0001H | 2 | Baud rate | 1 | W/R | 0:1200 1:2400 2:4800 3:9600 4:19200 5:38400 6:57600 7:115200 |
| 0002H | 3 | Positionin g interval | 1 | W/R | Value range 100ms~10000ms |
| 0003H | 4 | Latitude hemispher e | 1 | R | ASCIICode (0x4E)N,Northern Hemisphere (0x53)S, Southern Hemisphere |
| 0004H | 5 | latitude | 2 | R | E.g 3150.7797 -> 31°50'.7797 |
| 0005H | 6 | | | | |
| 0006H | 7 | Transhemi sphere | 1 | R | ASCII Code (0x45)E,Eastern Hemisphere (0x57)W, Western Hemisphere |
| 0007H | 8 | longitude | 2 | R | float E.g 11711.9287 -> 117°11'.9286 |
| 0008H | 9 | | | | |
| 0009H | 10 | Second Minute | 1 | R | UTC time |
| 000AH | 11 | Hour Day | 1 | R | |

| | | | | | |
|-------|----|-------|---|---|--|
| 000BH | 12 | Month | 1 | R | |
| | | Year | | | |

[Note] 1. Modbus read and write reply delay is 300ms~500ms under the default baud rate of 9600, Therefore, the waiting time of Modbus host should be at least more than 300ms;

(9)AWT100-WiFiWireless communication module parameter setting

AP: WIFI hotspot name

PASS: WIFI hotspot password

(10)AWT100-CEEthernet data conversion module parameter setting

(11)AWT100-DP data conversion module parameter setting

8 How to use

After setting the parameters of the AWT100 wireless communication terminal, confirm that the downlink equipment is operating normally and the gateway can communicate with the AWT100 wireless communication terminal normally. Wait for the AWT100 wireless communication terminal to establish a connection with the server, and send the device number to the server to distinguish the devices. At the same time, the AWT100 wireless communication terminal will poll the downstream device to query the online downstream device according to the set query address range and query register address field, and send the polled data to the server for reporting.

Headquarters: Acrel Co., LTD.

Address: No.253 Yulv Road Jiading District, Shanghai, China

TEL.: 0086-21-69158338 0086-21-69156052 0086-21-59156392 0086-21-69156971

Fax: 0086-21-69158303

Web-site: www.acrel-electric.com

E-mail: ACREL008@vip.163.com

Postcode: 201801

Manufacturer: Jiangsu Acrel Electrical Manufacturing Co., LTD.

Address: No.5 Dongmeng Road,Dongmeng industrial Park, Nanzha Street,Jiangyin City,Jiangsu Province,China

TEL./Fax: 0086-510-86179970

Web-site: www.jsacrel.com

Postcode: 214405

E-mail: JY-ACREL001@vip.163.com